

TEST REPORT No. 400752


Customer

BAROS VISION Ltd.

Asenovgradsko Shose - 4000 PLOVDIV - Bulgaria

Item[#]**railing named****“RAILING SYSTEM BV7600L top MOUNTING 66.2”**

Activity



resistance to horizontal linear static load according to standard UNI 10806:1999 and resistance to dynamic load according to standards UNI 10807:1999, NF P01-013:1988 and UNI EN 14019:2016

Results

| Test | Normative reference | Requirement | Result |
|-------------------------------|---------------------|-------------|------------------|
| horizontal linear static load | UNI 10807:1999 | 1,0 kN/m | compliant |
| dynamic load | UNI 10807:1999 | 300 mm | compliant |
| | NF P01-013:1988 | 1200 mm | compliant |
| | UNI EN 14019:2016 | 950 mm | compliant |

(#) according to that stated by the customer.

Bellaria-Igea Marina - Italy, 15 December 2022

Chief Executive Officer

Order:
94630Item origin:
sampled and supplied by the customerIdentification of item received:
2022/2834/A dated 12 December 2022Activity date:
12 December 2022Activity site:
Istituto Giordano S.p.A. - Strada Erbosa Uno, 72 -
47043 Gatteo (FC) - Italy

| Contents | Page |
|----------------------------------|------|
| Description of item [#] | 2 |
| Normative references | 3 |
| Apparatus | 3 |
| Method | 4 |
| Environmental conditions | 4 |
| Results | 5 |
| Findings | 7 |

This document is made up of 7 pages and shall not be reproduced except in full without extrapolating parts of interest at the discretion of the customer, with the risk of favoring an incorrect interpretation of the results, except as defined at contractual level.

The results relate only to the item examined, as received, and are valid only in the conditions in which the activity was carried out.

The original of this document consists of an electronic document digitally signed pursuant to the applicable Italian Legislation.

Chief Test Technician:

Dott. Andrea Bruschi

Head of Security and Safety Laboratory:

Dott. Andrea Bruschi

Compiler: Francesca Manduchi

Reviewer: Dott. Andrea Bruschi

Page 1 of 7


Description of item[#]

The item under examination consists of laminated tempered glass railing with aluminium structure, having the characteristics shown in the following table.


| | |
|--|--|
| Overall width | 1000 mm |
| Overall height from floor | 1100 mm |
| Glass type | laminated glass 66.2 (tempered + PVB + tempered) |
| Dimensions of glass | 1000 mm × 1100 mm |
| Nominal thickness of glass | 12,76 mm |
| Nominal section of aluminum profile | 119,0 mm × 99,0 mm |

Further details of item specifications can be seen in customer-supplied schematic drawing shown below.

CROSS SECTION SUPPLIED BY THE CUSTOMER

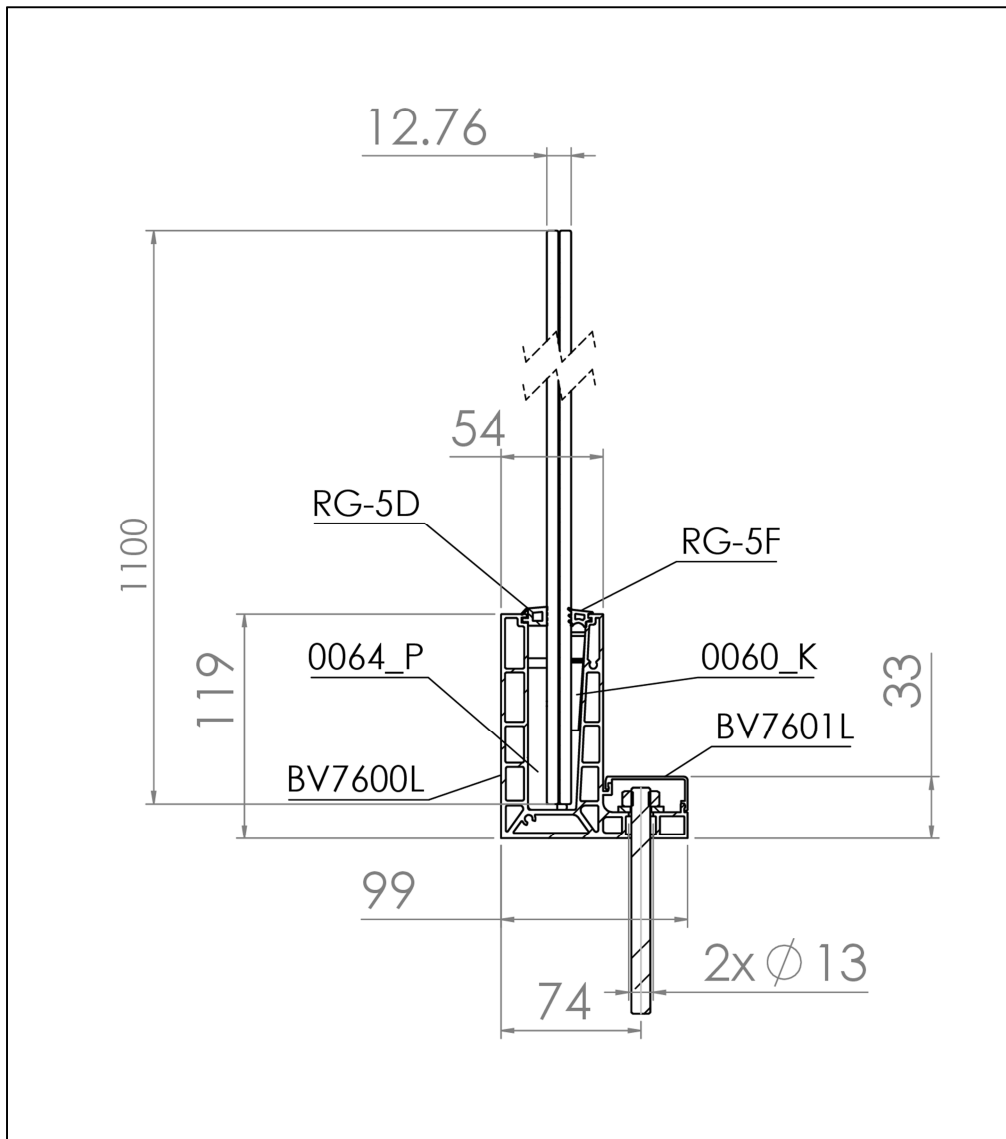

(#) according to that stated by the customer; Istituto Giordano declines all responsibility for the information and data provided by the customer that may influence the results.

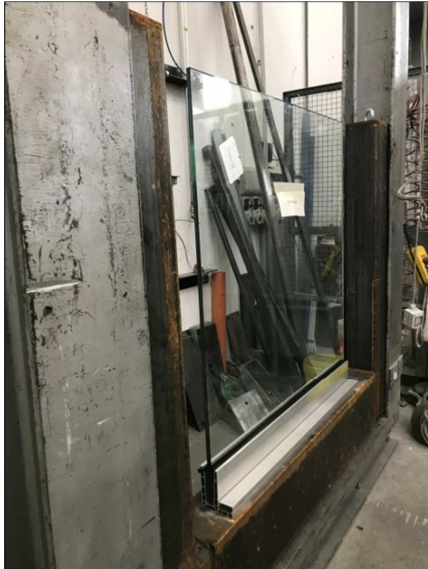

Photograph of the item



Label detail

Normative references

| Standard | Title |
|-------------------|--|
| UNI 10806:1999 | Ringhiere, balaustre o parapetti prefabbricati - Determinazione della resistenza meccanica ai carichi statici distribuiti (<i>Prefabricated railing systems - Determination of the mechanical strength under distributed static loads</i>) |
| UNI 10807:1999 | Ringhiere, balaustre o parapetti prefabbricati - Determinazione della resistenza meccanica ai carichi dinamici (<i>Prefabricated railing systems - Determination of the mechanical strength under dynamic load</i>) |
| NF P01-013:1988 | Essais des garde-corps - Méthodes et critères (<i>Railing tests - Methods and criteria</i>) |
| UNI EN 14019:2016 | Facciate continue - Resistenza all'urto - Requisiti prestazionali (<i>Curtain walling - Impact resistance - Performance requirements</i>) |

Apparatus

| Description | In-house identification code |
|---|------------------------------|
| steel frame simulating actual installation of the item on the floor | EDI048 |
| pneumatic equipment for the simulation of the static load | // |
| 3 Gefran digital displacement transducers "PZ-34-S150", range of measurement 0-150 mm | FT451/1, FT451/2, FT451/3 |
| AEP Transducers load cell "TS" with digital indicator "DFI", range of measurement 100-1000 N | EDI104 |
| Borletti digital electronic gauge "CDEP15", range of measurement 0-150 mm and resolution 0,01 mm | EDI066 |
| Mitutoyo Corporation digital meter "TD-S551D1 216-452", range of measurement 0-5,5 m | FT364 |
| steel frame simulating actual installation of the item on the floor | EDI048 |
| soft body consisting of spheroconical bag, diameter 0,40 m and height 0,60 m, filled with hardened glass beads, diameter 3 mm, until reaching a total mass of 50 kg | EDI062 |
| Istituto Giordano double pneumatic impactor complying with standard UNI EN 12600:2004 "Vetro per edilizia - Prova del pendolo - Metodo della prova di impatto e classificazione per il vetro piano" (<i>Glass in building - Pendulum test - Impact test method and classification for flat glass</i>), total mass 50 kg | EDI012 |
| Würth telescopic measuring rod "mEssfix", range of measurement 0-5000 mm and resolution 0,1 mm | EDI083 |

Method

Test was carried out using detailed internal procedure PP083 in its current revision at testing date.

The bottom side of the item was side fixed to the steel frame simulating the actual installation of the item.

Procedure

| Normative reference | Activity | Description/parameters |
|--|--|---|
| table 3.1.II of D.M. Infrastructures 17 January 2018 | load determination | // |
| UNI 10806:1999 | resistance to horizontal linear static load | <p>The three digital displacement transducers were positioned on the item in order to read the relative displacement of the upper edge of the glazing, two at the ends and one in the middle between them.</p> <p>In particular it has been carried out the following test sequence:</p> <ul style="list-style-type: none"> - pre-load equal to 50 % of the load defined by the customer; - removal of the preload and detection of the initial position of the edge of the plate; - application of the load in a progressive manner with a time ≥ 5 s, with deformations under load recording after 15 min; - load removal and registration of residual deformation after 5 min. |
| UNI 10807:1999 | resistance to dynamic load | <p>All impacts were made by releasing the impactors so that they fall from a specified height with a pendulum movement and without initial velocity. The impactors were hung by an inextensible pendulum wire of negligible mass so that when at rest they made contact with the point of intended impact. After each impact, the impactors were prevented from hitting the item again after bouncing.</p> |
| NF P01-013:1988 | | |
| UNI EN 14019:2016 | | |

Environmental conditions

| | |
|-------------------|-------------|
| Temperature | (19 ± 2) °C |
| Relative humidity | (52 ± 5) % |

Results

Resistance to horizontal linear static load

| Applied load [kN/m] | Deflection whilst loaded at the point of measure | | | Permanent deflection at the point of measure | | | Result |
|------------------------|---|-----------|-----------|---|-----------|-----------|-----------|
| | A [mm] | B [mm] | C [mm] | A [mm] | B [mm] | C [mm] | |
| 1,0 | 58 | 60 | 58 | 6,4 | 5,6 | 5,5 | no damage |



Photograph of the item undergoing horizontal linear static load

Resistance to dynamic load

| Standard | Impact area | Drop height [mm] | Nominal energy [J] | Result |
|-------------------|-------------------|---------------------|-----------------------|-----------|
| UNI 10807:1999 | centre of glazing | 300 | 150 | no damage |
| NF P01-013:1988 | centre of glazing | 1200 | 600 | no damage |
| UNI EN 14019:2016 | centre of infill | 950 | 466 | no damage |



Photograph of the item after impact on the centre of the glazing according to standard NF P01-013:1988



Photograph of the item after impact on the centre of the glazing according to standard UNI EN 14019:2016

Findings

| Test | Normative reference | Requirement | Result [#] |
|-------------------------------|---------------------|-------------|---------------------|
| horizontal linear static load | UNI 10807:1999 | 1,0 kN/m | compliant |
| dynamic load | UNI 10807:1999 | 300 mm | compliant |
| | NF P01-013:1988 | 1200 mm | compliant |
| | UNI EN 14019:2016 | 950 mm | compliant |

(#) the compliance with the provisions of reference standards has been determined on the basis of the values obtained by measurements in line with clause 4.2 "Decision Rules" of ILAC-G8:09/2019 guide "Guidelines on Decision Rules and Statements of Conformity".

Chief Test Technician
(Dott. Andrea Bruschi)

Andrea Bruschi

Head of
Security and Safety Laboratory
(Dott. Andrea Bruschi)

Andrea Bruschi